

Y-strainer type 36



Body material	PVC-U	PP	PVDF
Sealing material (optionally)	• EPDM		• FKM
Working temperature	0 °C up to 60 °C ¹⁾	- 20 °C up to 80 °C ¹⁾	- 20 °C up to 120 °C ¹⁾
Nominal size	DN 15 up to DN 50		
Connection with pipe	Cement spigot	<ul style="list-style-type: none"> • True union with -cement- / welding socket -welding spigot 	<ul style="list-style-type: none"> • Flange with dimensions acc. to DIN EN 1092-1 (replaces DIN 2501) - PN 10
Length	Company standard	Company standard	DIN EN 558-1 series FTF 1 (DIN 3202 - series F 1)
Mesh width	0,5 mm ²⁾		

²⁾ 0,25 mm or 1,0 mm on request

¹⁾ Working temperatures for sealing materials:

EPDM: -20 up to 90 °C
 FKM: -20 up to 120 °C


Example for an invitation to tender text:

Y-strainer type 36, DN 40, PN 10, PVC-U / EPDM, flange connection acc. to DIN EN 1092-1 - PN 10, length acc. to DIN EN 558-1 series FTF 1, mesh width 0,5 mm


Document: FRANK_DB_L7_Schrägsitz-Schmutzfänger Typ 36_04-2012_EN

Y-strainer type 36, PVC-U


Basic valve

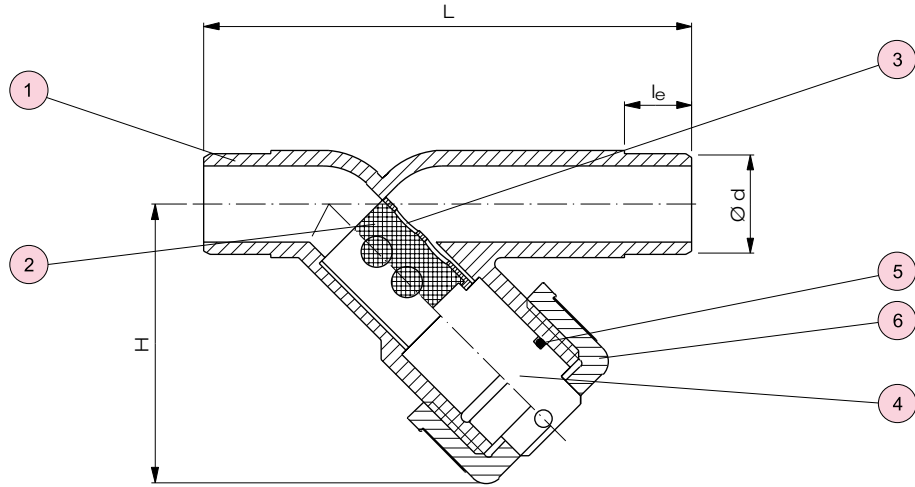


Flange

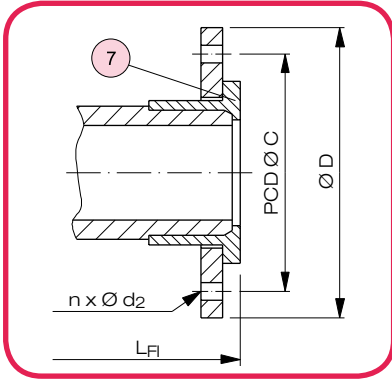

True union with spigot

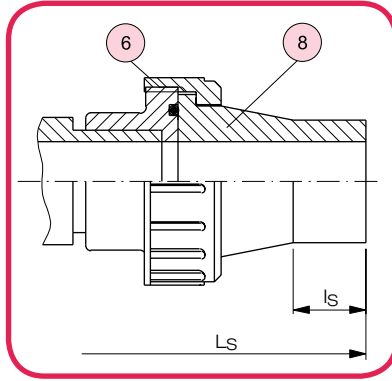

True union with socket

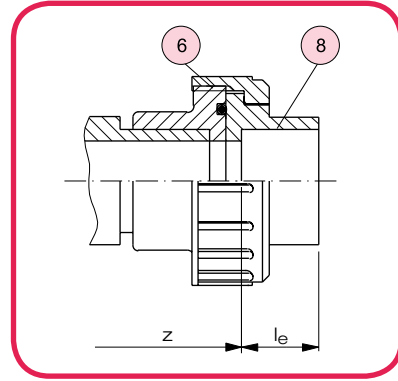

No.	Description	Number	Material
1	Body	1	PVC-U
2	Filter screen ^{*)}	1	ETFE
3	Screen support	1	PVC-U
4	Screen union nut	1	PVC-U


No.	Description	Number	Material
5	O-ring ^{*)}	1	EPDM, FKM ³⁾
6	Union nut	1	PVC-U
7	Flange adaptor and backing ring ¹⁾	2	PVC-U
8	True union with connection ²⁾	2	PVC-U / PP

^{*)} Wearing parts
¹⁾ for flanged version

²⁾ for true union version with socket / spigot
³⁾ Special version: CSM, NBR, FEP / Parofluor on request

Dimensions in mm											Weight in kg / pc.				
DN	d	H	Spigot		Flange				True union Socket / spigot				Basic valve	Flange	True union Socket / spigot
			L	le	LFI	D	n x d2	C	z	le	Ls	ls			
15	20	75	124	17	130	95	4 x 14	65	150	16	252	38	0,18	0,36	0,26
20	25	80	144	18	150	105	4 x 14	75	170	18	278	39	0,20	0,46	0,33
25	32	90	154	20	160	115	4 x 14	85	180	20	294	39	0,30	0,67	0,50
32	40	110	174	23	180	140	4 x 18	100	204	22	320	42	0,48	1,03	0,84
40	50	128	194	26	200	150	4 x 18	110	228	24,5	342	44	0,79	1,42	1,21
50	63	150	224	30	230	165	4 x 18	125	266	29	384	44	1,32	2,30	2,04

Y-strainer type 36, PP and PVDF

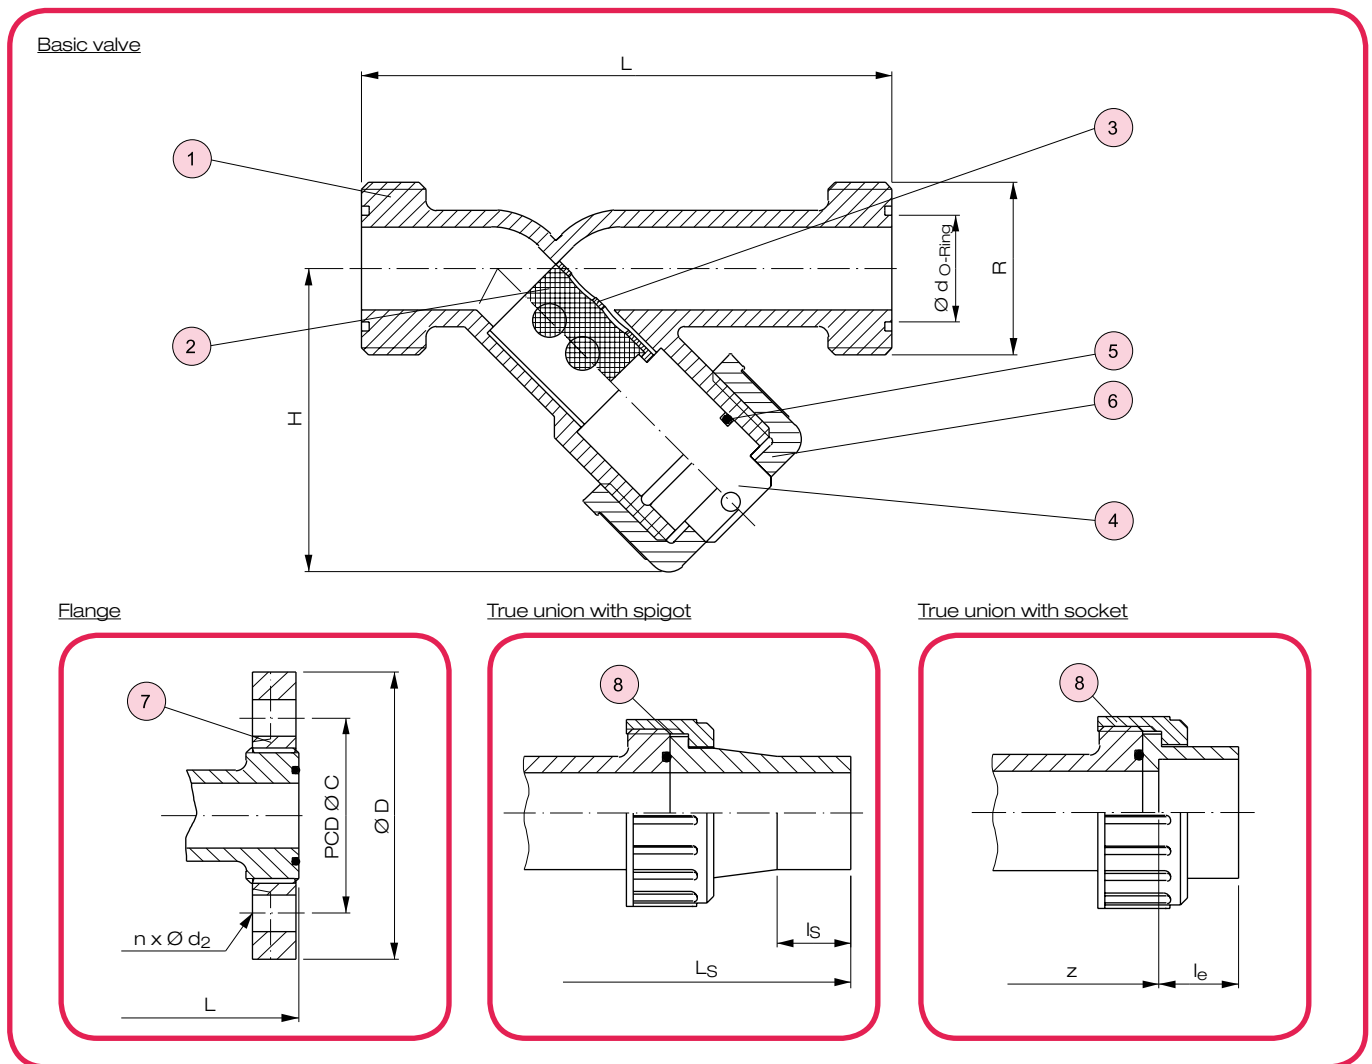

No.	Description	Number	Material
1	Body	1	PP, PVDF
2	Filter screen ^{*)}	1 (2)	ETFE
3	Screen support	1	PP, PVDF
4	Screen union nut	1	PP, PVDF

No.	Description	Number	Material
5	O-ring ^{*)}	1	EPDM, FPM ³⁾
6	Union nut	1	PP, PVDF
7	Threaded flange ¹⁾	2	PP-FRP
8	True union with connection ²⁾	2	PP, PVDF / PE 100

^{*)} Wearing parts

¹⁾ for flanged version


²⁾ for true union version with socket / spigot

³⁾ Special version: CSM, NBR, FEP / Parofluor on request

DN	Dimensions in mm												Weight in kg / pc.			
	Spigot					Flange			True union Socket / spigot				Basic valve		Flange	
	d	d _{O-Ring}	H	L	R	D	n x Ø d ₂	C	z	l _e	L _S	l _S	PP	PVDF	PP	PVDF
15	20	20,22 x 3,53	75	130	36 x 1/8"	95	4 x 14	65	136	16	238	38	0,15	0,26	0,17	0,44
20	25	29,75 x 3,53	80	150	48 x 1,6"	105	4 x 14	75	156	18	264	39	0,16	0,30	0,18	0,56
25	32	36,09 x 3,53	90	160	52 x 1,6"	115	4 x 14	85	166	20	280	39	0,23	0,49	0,26	0,83
32	40	40,64 x 5,33	110	180	65 x 1,6"	140	4 x 18	100	186	22	306	42	0,38	0,80	0,42	1,38
40	50	46,99 x 5,33	128	200	72 x 1,6"	150	4 x 18	110	206	24,5	334	44	0,57	1,23	0,64	1,89
50	63	59,69 x 5,33	150	230	85 x 1,6"	165	4 x 18	125	230	29	368	44	0,95	1,77	1,83	2,65

Y-strainer type 36

Pressure loss diagram

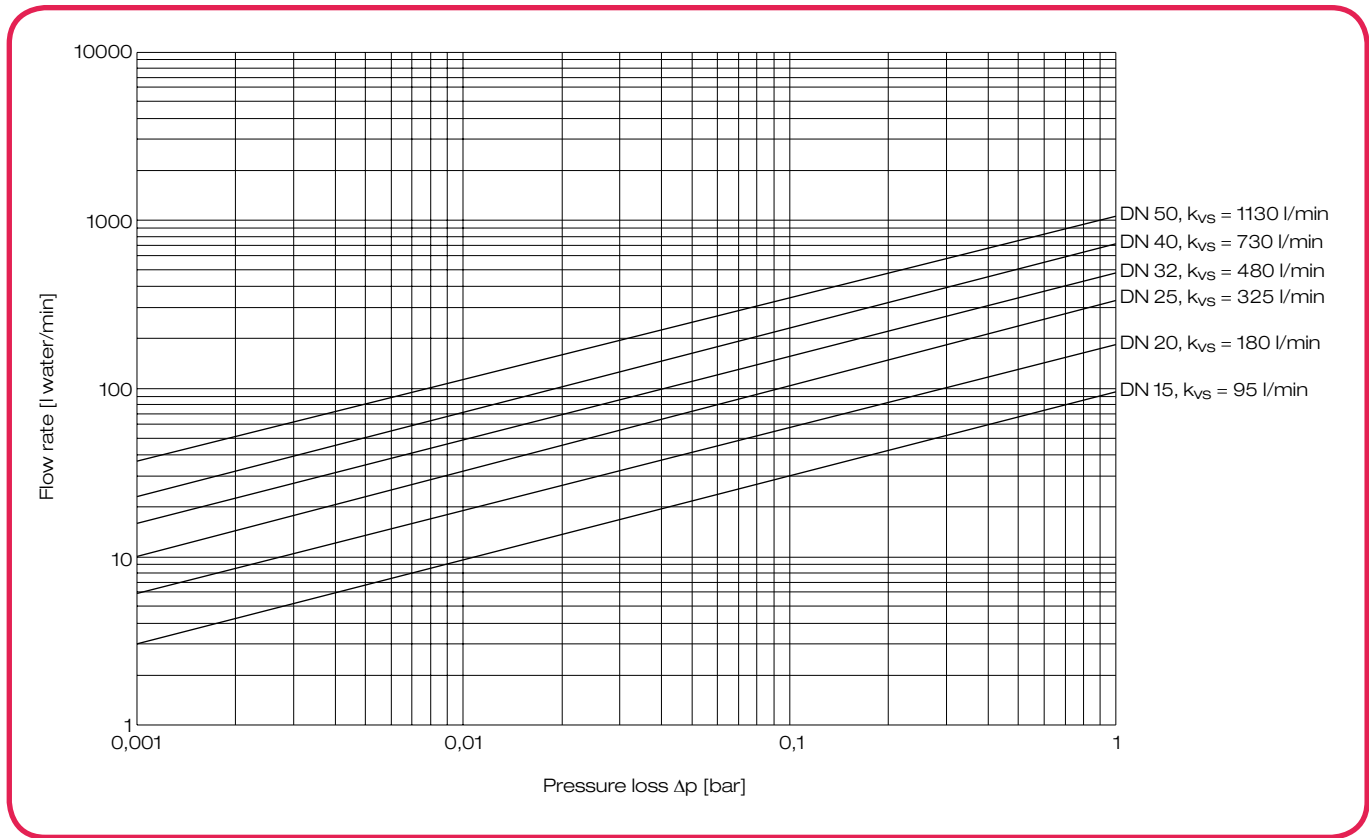

Operating instructions

Working pressure p_B in bar

Body material	T_B [°C]	p_B [bar]
PVC-U	0 up to 20	10
	40	6
	60	1
PP	- 20 up to 30	10
	60	4,2
	80	1,5
PVDF	- 20 up to 20	16
	80	10
	120	4

Maintenance

- An inspection and maintenance has to be performed in regular intervals.

Disassembly of the valve

Attention: Never dismantle the valve when the pipe is under pressure.

- Loosen the union nuts 6 by hand or with a belt key. Avoid inadequate force.
- Loosen the screen union nut 6 and carefully pull out the screen support.
- Pull out the filter screen 2 of the screen support 3.
- Remove the o-ring 5 from the screen union nut 4.

Attention: Use suitable tools for the o-rings to prevent them from being damaged.

Assembly of the valve

- The valve assembly is to be performed in reverse order to the disassembly.
- Before the assembly all parts have to be checked for damages.
- All parts have to be clean.
- For assembly of o-ring 5 a silicone-free lubricant may be used.
- After assembly carry out a pressure test acc. to DIN EN 12266-1.

Notes for correct installation

- The valve must be installed stress-free in the pipe (plane parallelism, axial, overall length).
- Flanged connection:
The flange bolts have to be tightened equably. In general, use washers for the nuts and bolts in plastic flanges.
- Socket and spigot joint:
The cementing or welding process has to be performed acc. to the relevant guidelines (e. g. DVS).
- The valve has to be installed with direction indicator pointing in flow direction.